

Report No.: 56.02313 NOVAL Recessed Downlight Test Time: 2023-09-06 16:49

Luminaire Property

Luminaire Category: Bridgelux V3 3000K CRI90

Voltage: 221.6 V

Current: 0.021 A

Power: 3.80 W

Power Factor: 0.804

Photometric Results

CIE Class: Direct

Measurement Flux: 176.5 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H17.1

Vertical Diffuse Angle(50%): V17.1

Luminaire Efficacy Rating (LER): 46

Max. Intensity: 1519.08 cd

Total Rated Lamp Lumens: 176.5 lm

Efficiency: 100%

Upward Ratio: 0%


Central Intensity: 1519.08 cd

Pos of Max. Intensity: H0 V0

Picture Of Luminaire



Luminous Intensity Distribution Curve

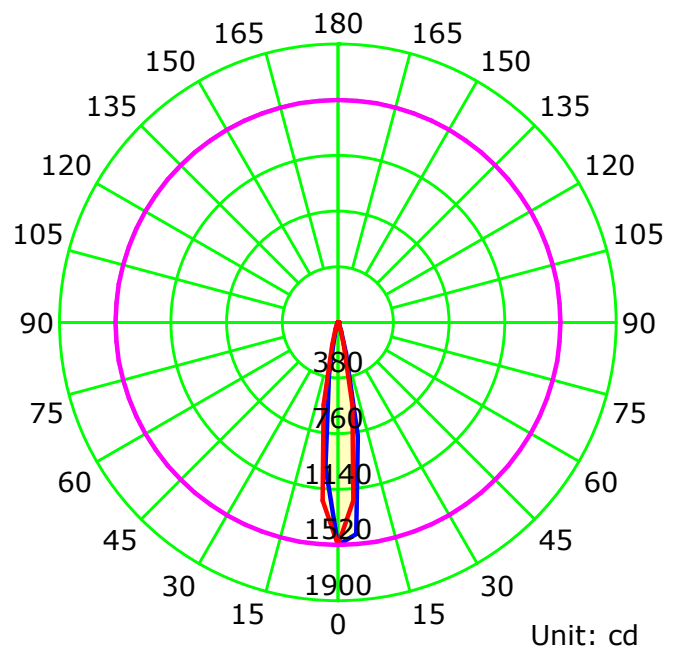

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

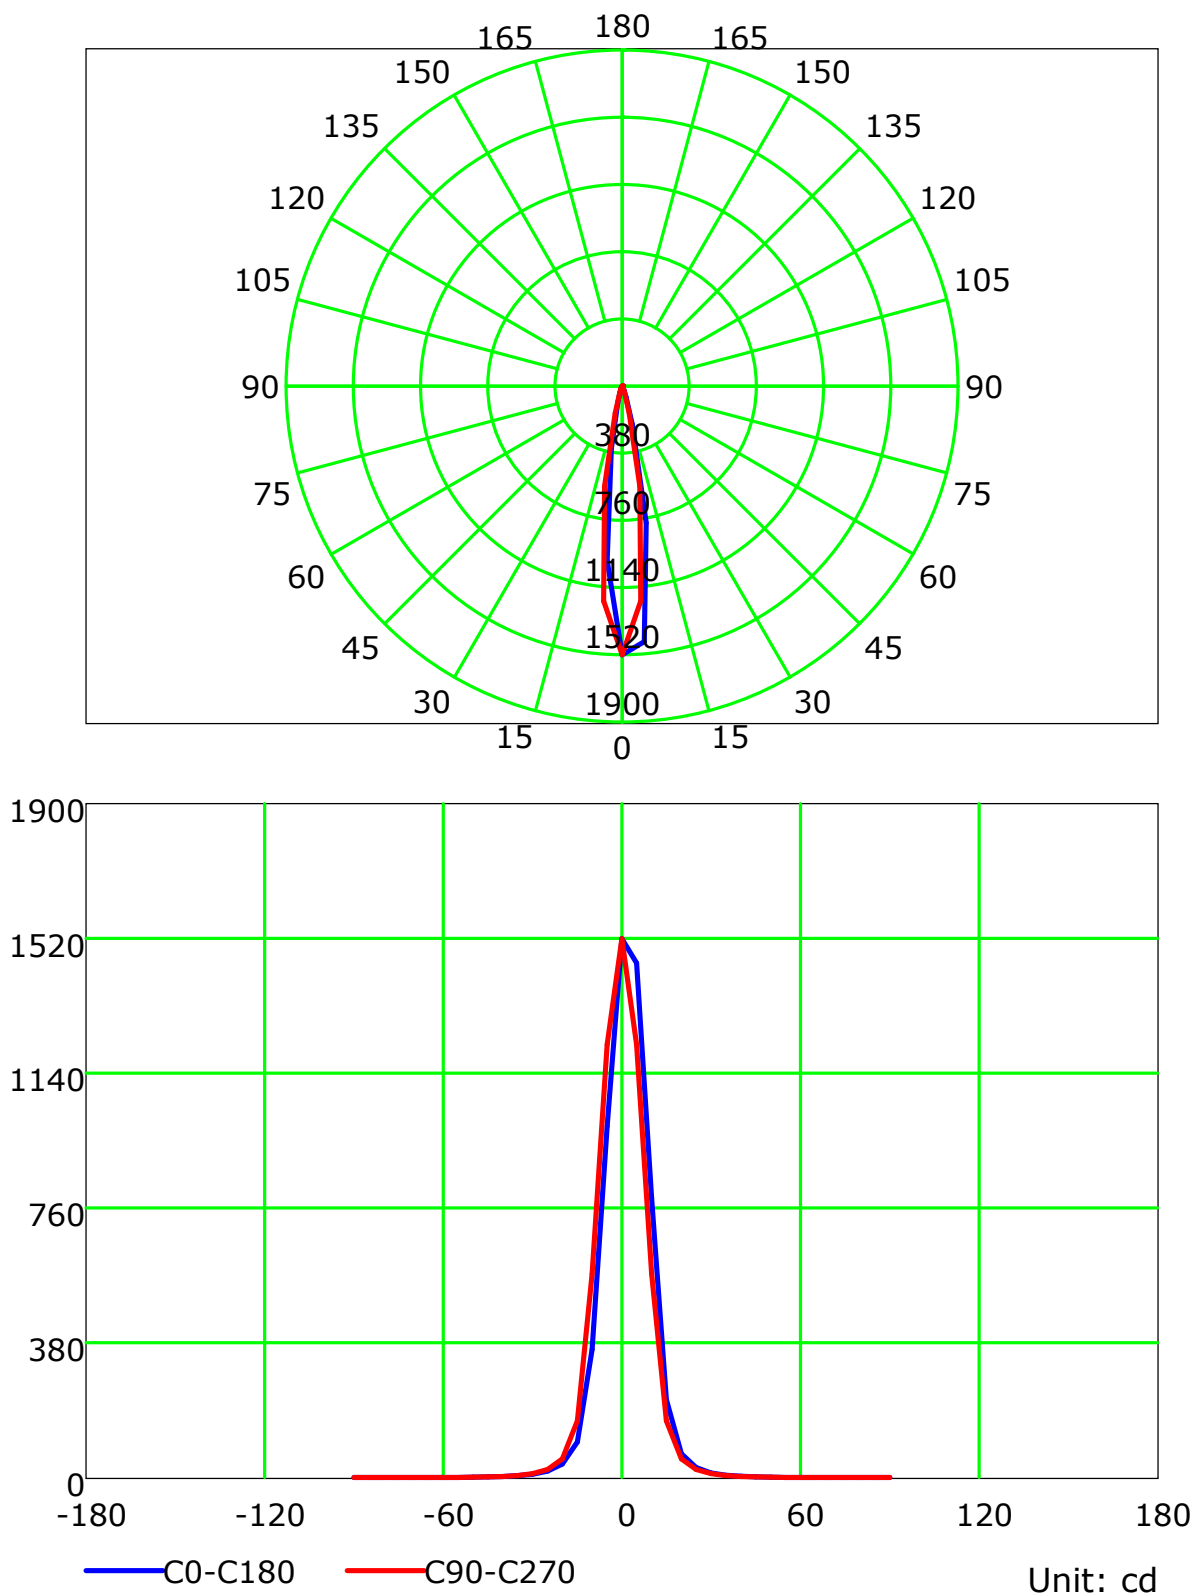

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Isocandela (rectangle)

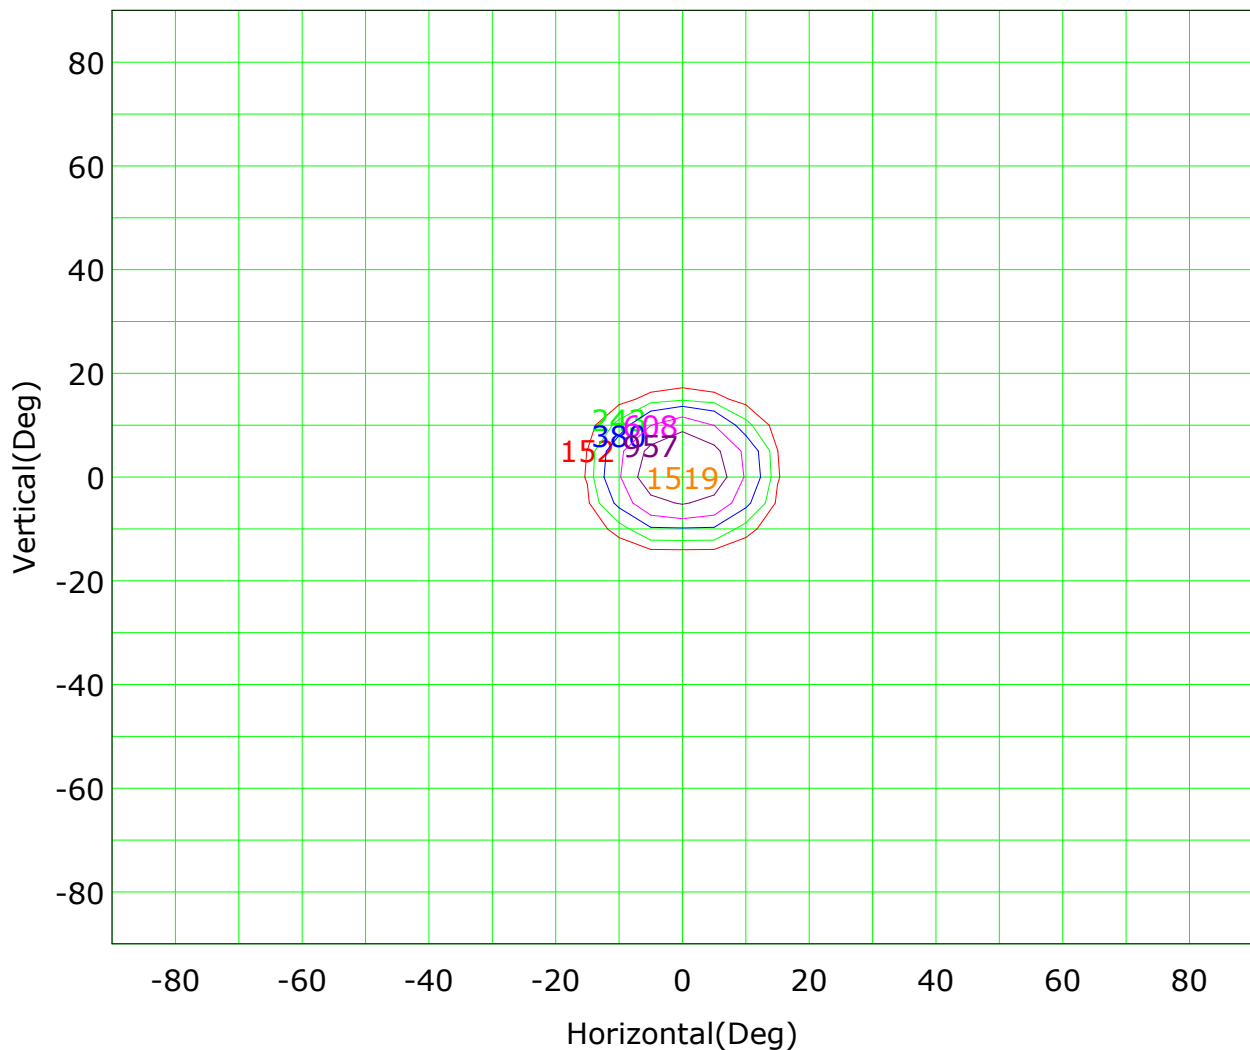

Imax (100%): 1519 cd

(10%): 152 cd	(16%): 243 cd
(25%): 380 cd	(40%): 608 cd
(63%): 957 cd	(100%): 1519 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

IsoLux Plot

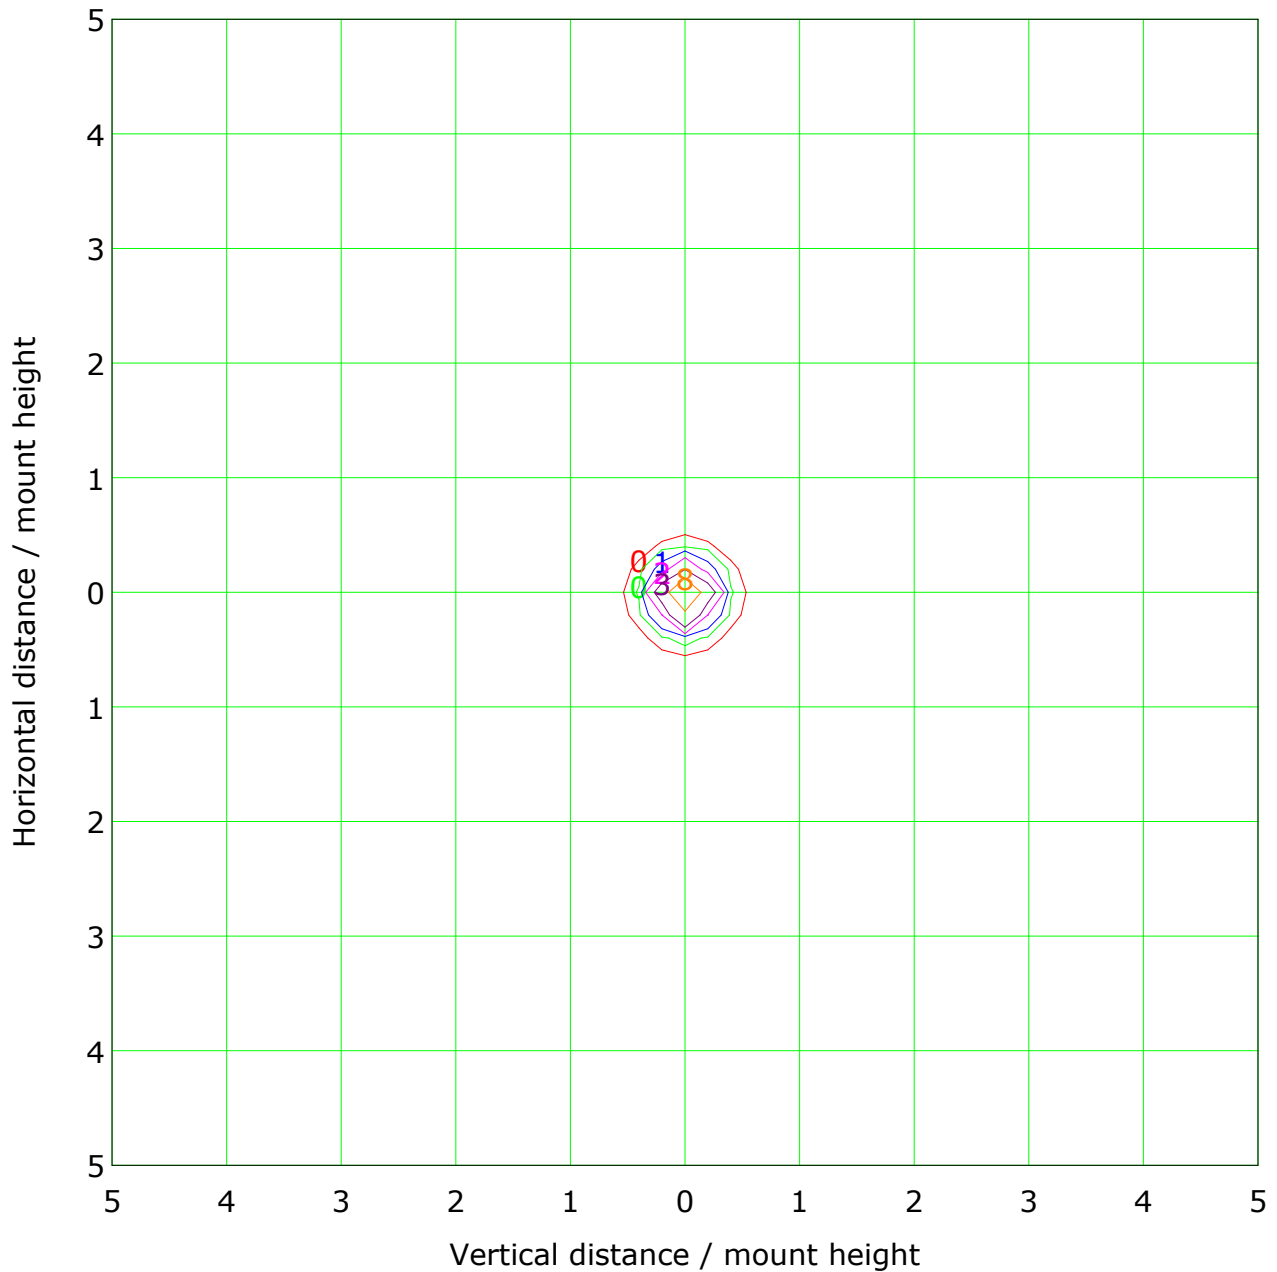


Mounting Height: 10m		Max Lux(100%): 15 lx	
(1%):	0 lx	(2%):	0 lx
(5%):	1 lx	(10%):	2 lx
(20%):	3 lx	(50%):	8 lx
(100%):	15 lx		


C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Illuminance at a Distance

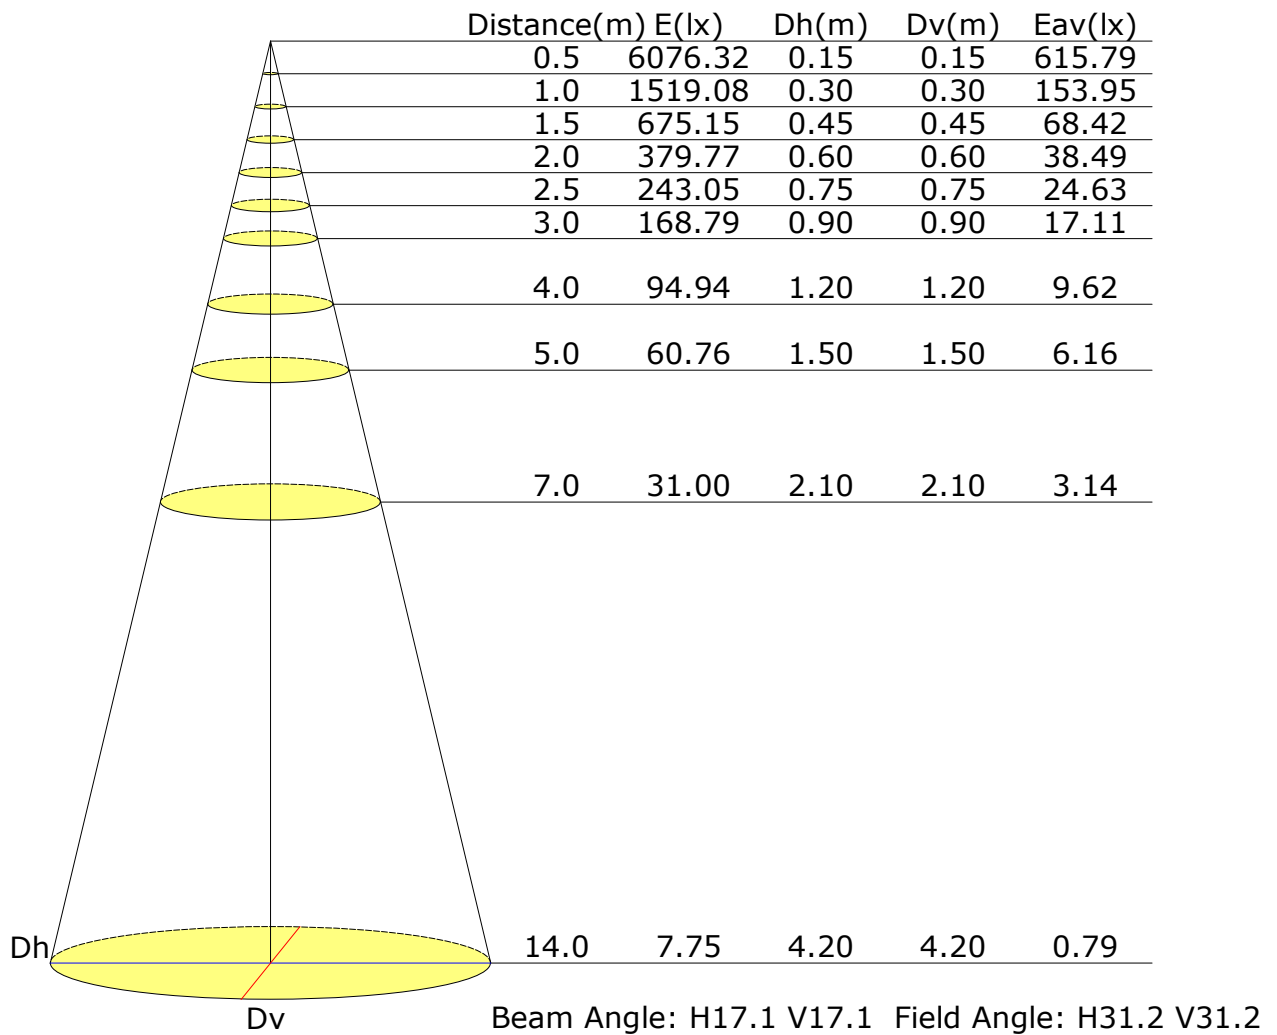

Vertical IsoLux Plot

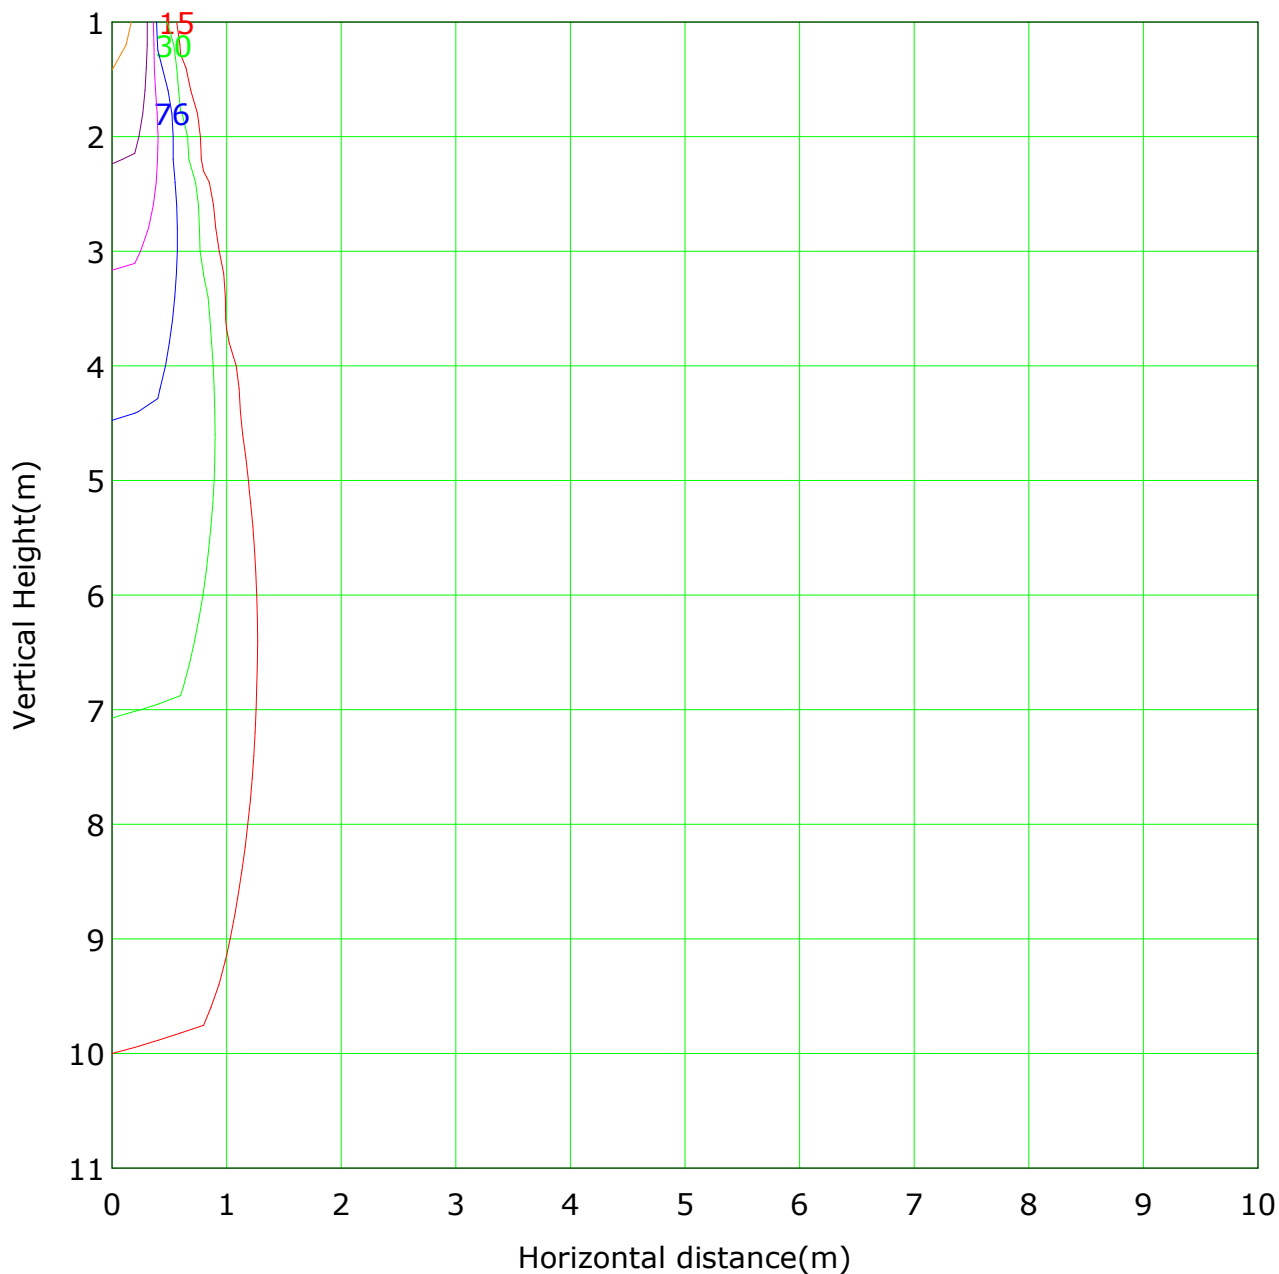


Lowest(m): 1m Highest(m): 11 Max Lux: 1519

(1%): 15 lx	(2%): 30 lx
(5%): 76 lx	(10%): 152 lx
(20%): 304 lx	(50%): 760 lx
(100%): 1519 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

The average illuminance effective figure

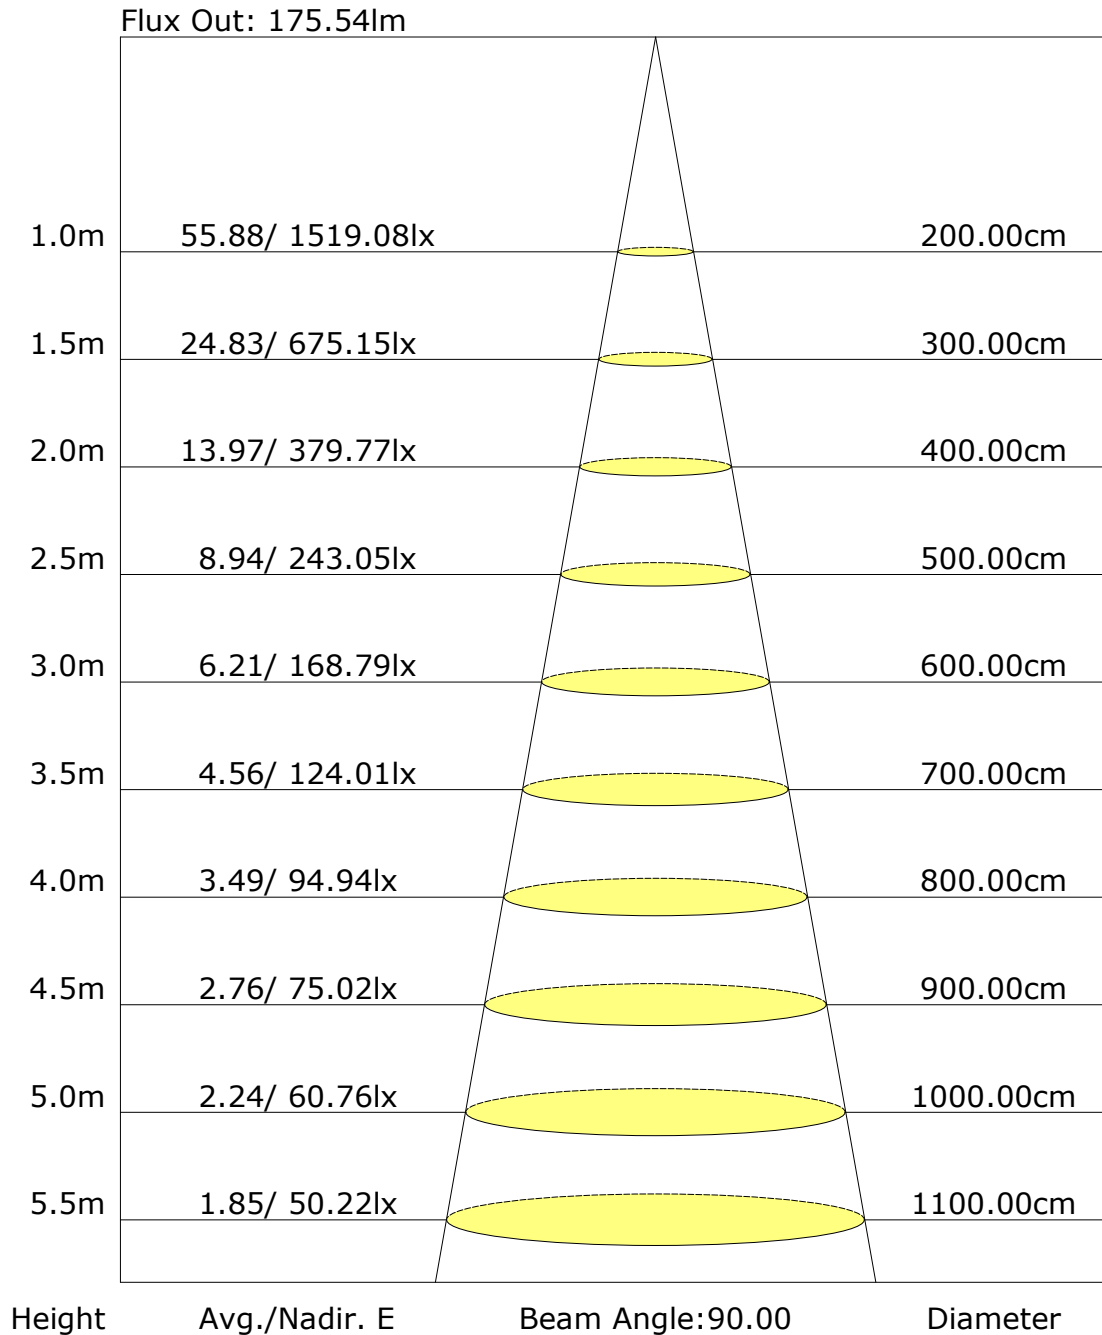

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector: