

Report No.: 56.02313 NOVAL Recessed Downlight

Test Time: 2023-09-06 16:58

Luminaire Property

Luminaire Category: Bridgelux V3 3000K CRI90

Voltage: 221.2 V

Current: 0.021 A

Power: 3.80 W

Power Factor: 0.808

Photometric Results

CIE Class: Direct

Measurement Flux: 164.1 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H26.3

Vertical Diffuse Angle(50%): V26.3

Luminaire Efficacy Rating (LER): 43

Max. Intensity: 676.31 cd

Total Rated Lamp Lumens: 164.1 lm

Efficiency: 100%

Upward Ratio: 0%


Central Intensity: 591.17 cd

Pos of Max. Intensity: H180 V5

Picture Of Luminaire



Luminous Intensity Distribution Curve

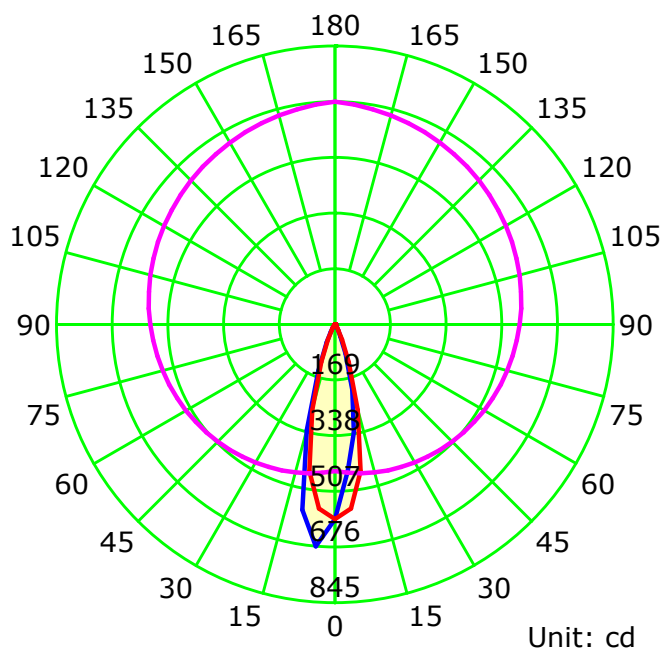

— C0-C180 — C90-C270 — G5

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0



Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

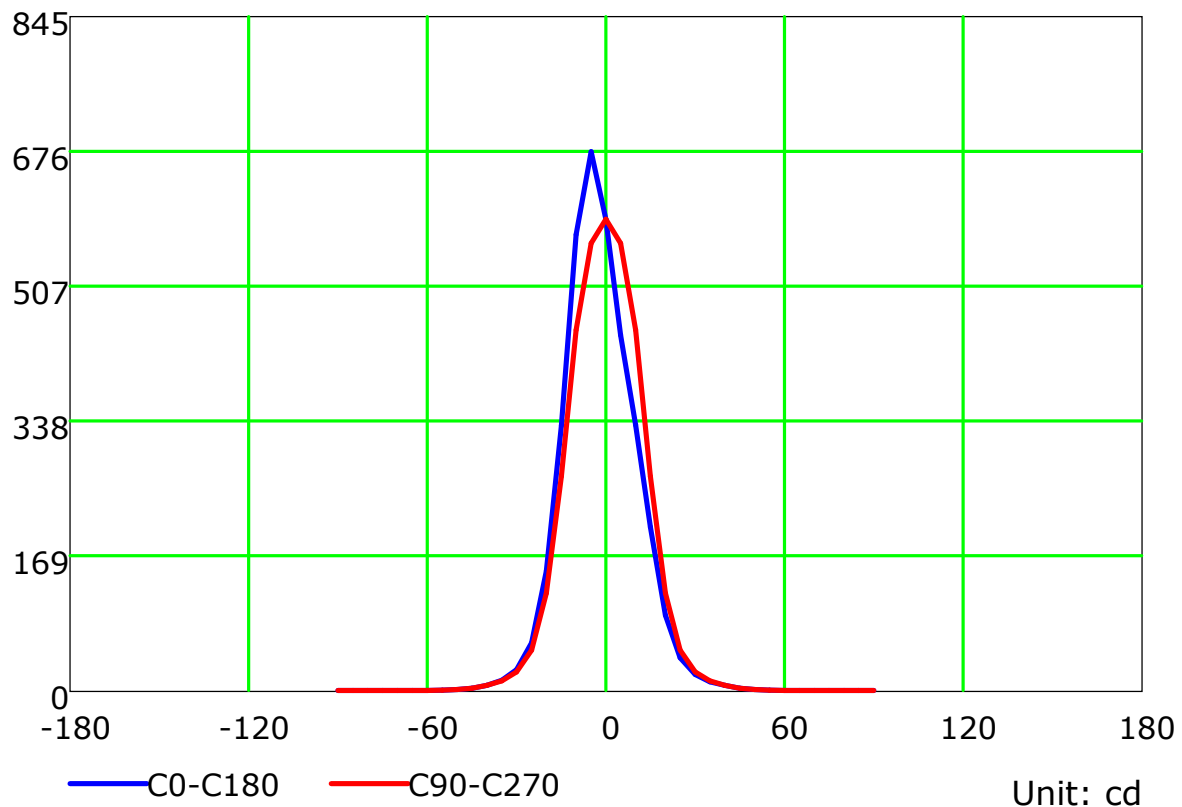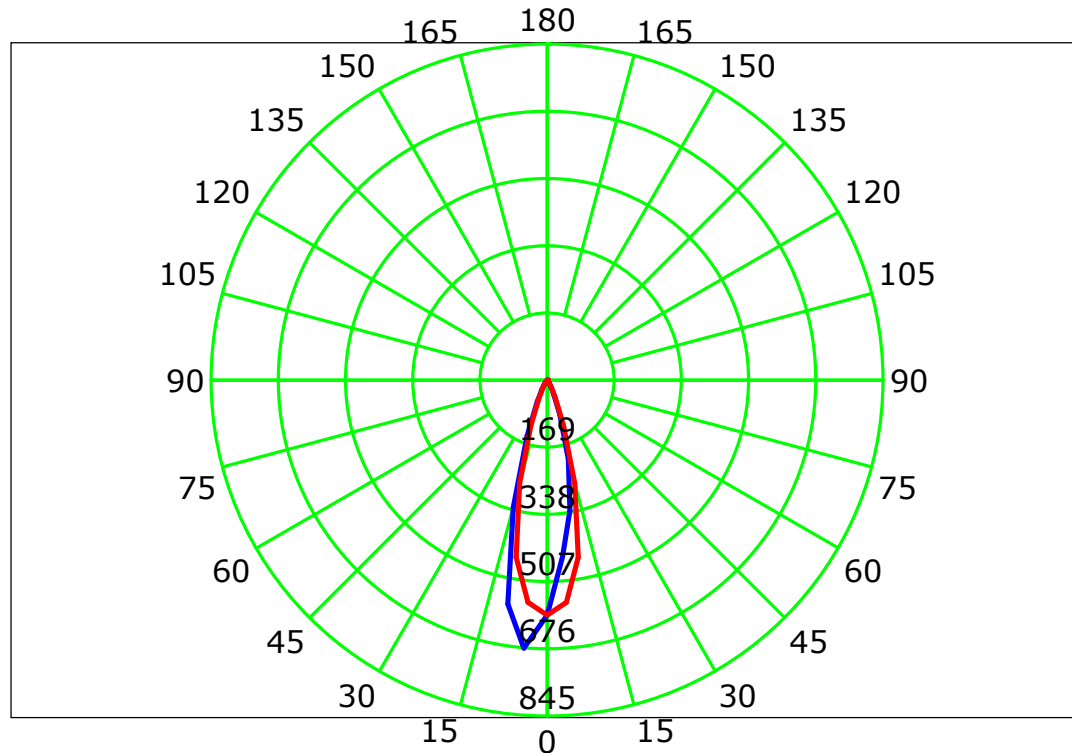

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Isocandela (rectangle)

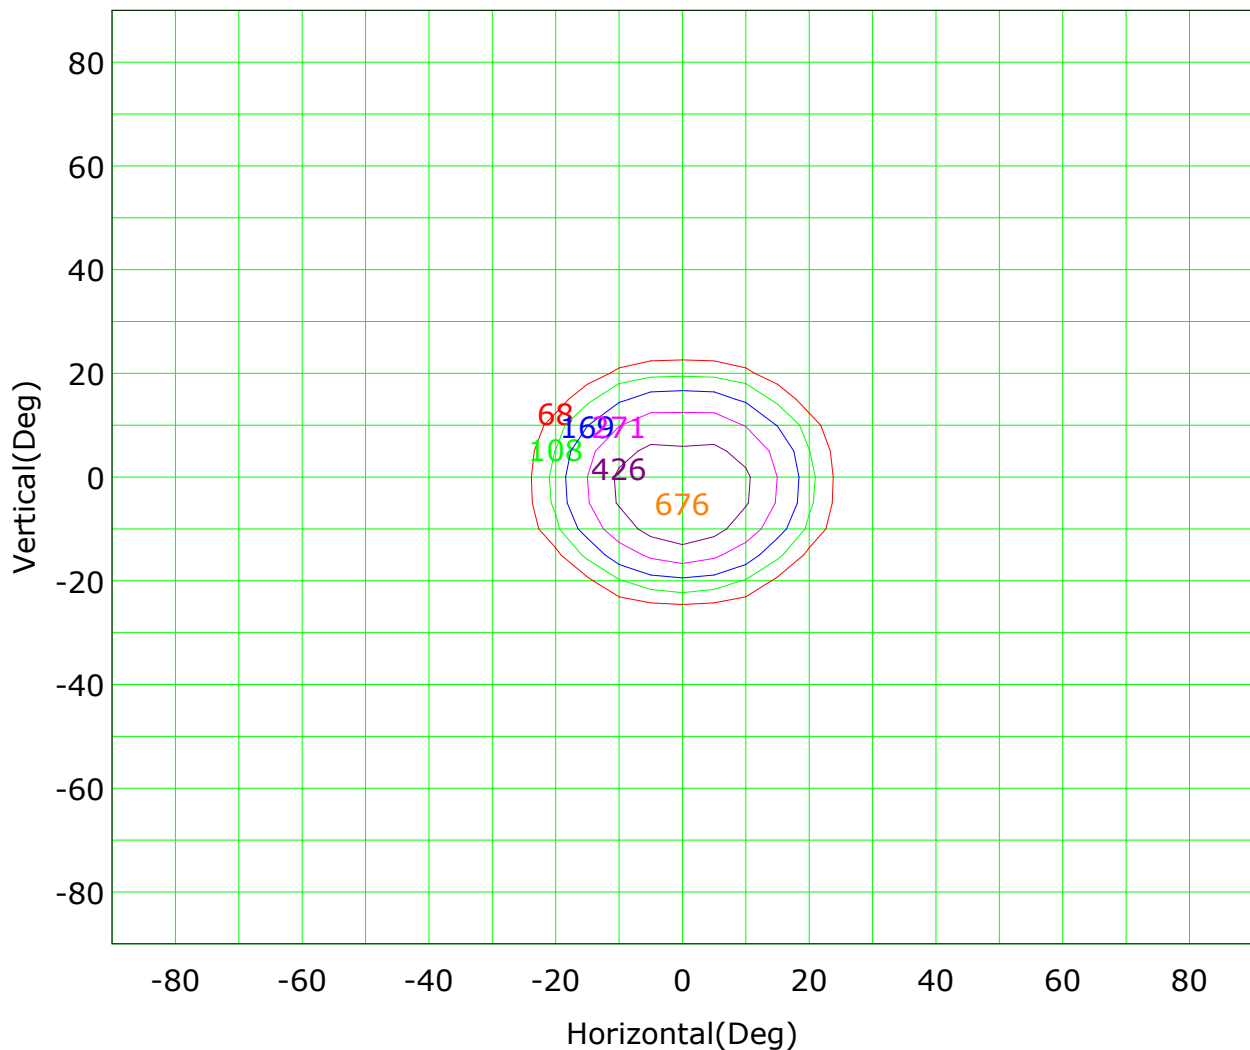

Imax (100%): 676 cd

(10%):	68 cd	(16%):	108 cd
(25%):	169 cd	(40%):	271 cd
(63%):	426 cd	(100%):	676 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:5.0


Test Device: CHL-6E

Distance: 3.000 m

Humidity:

Inspector:

IsoLux Plot

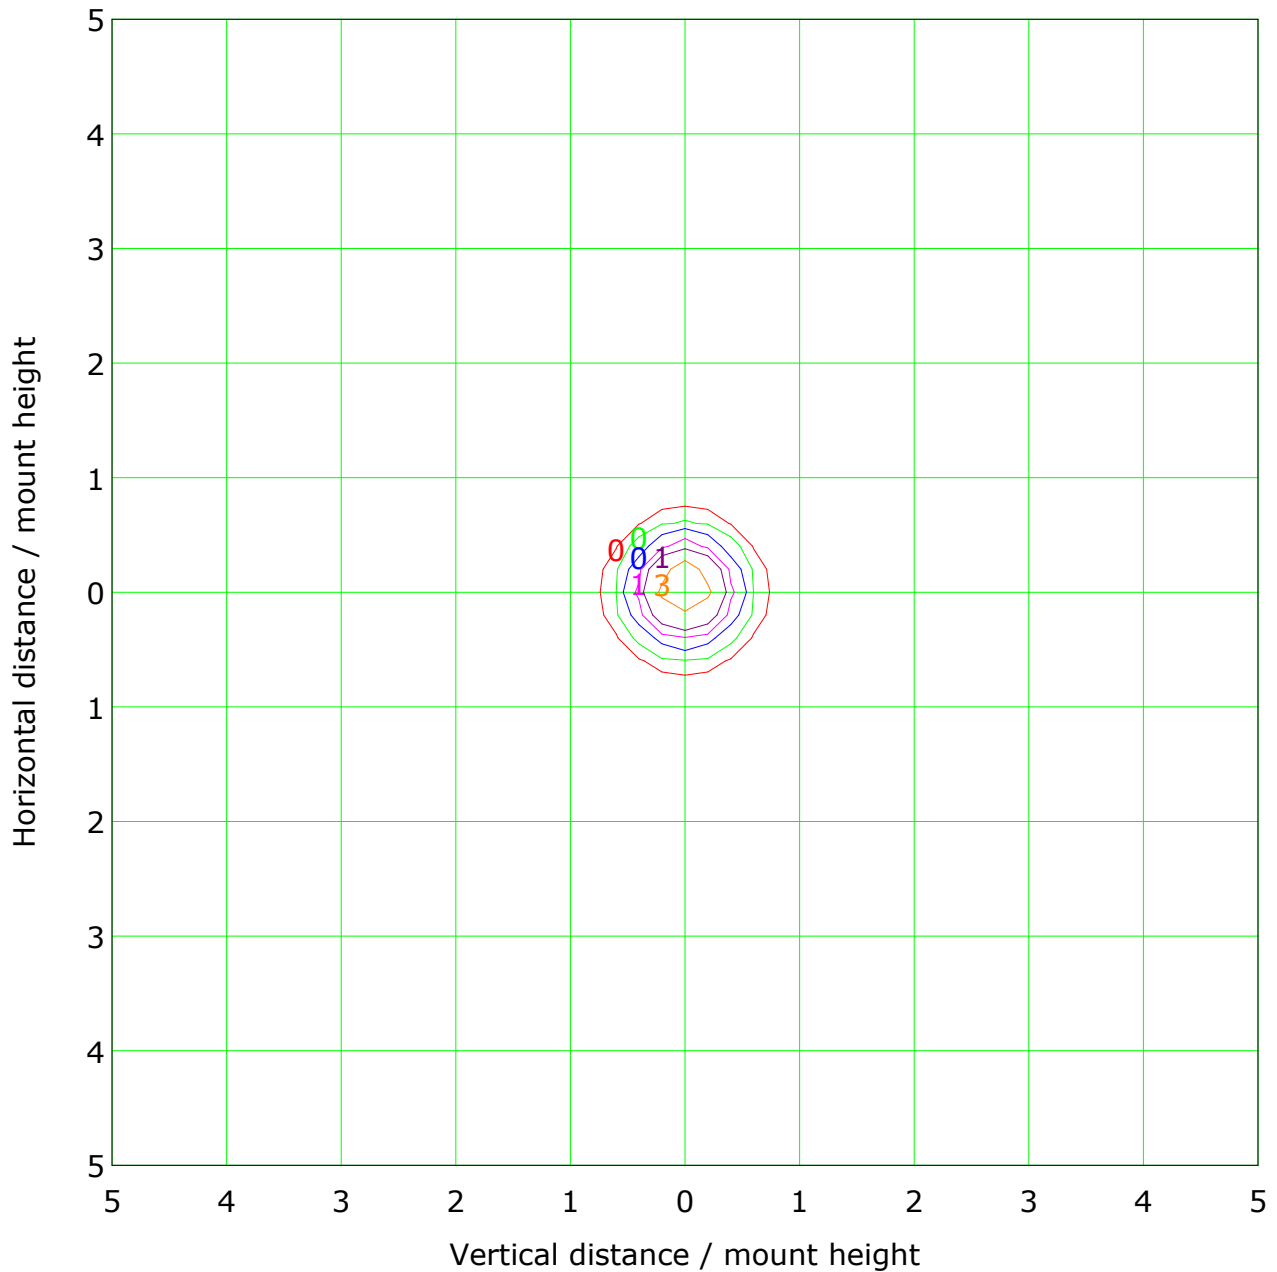


Mounting Height: 10m		Max Lux(100%): 7 lx	
(1%):	0 lx	(2%):	0 lx
(5%):	0 lx	(10%):	1 lx
(20%):	1 lx	(50%):	3 lx
(100%):	7 lx		


C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Illuminance at a Distance

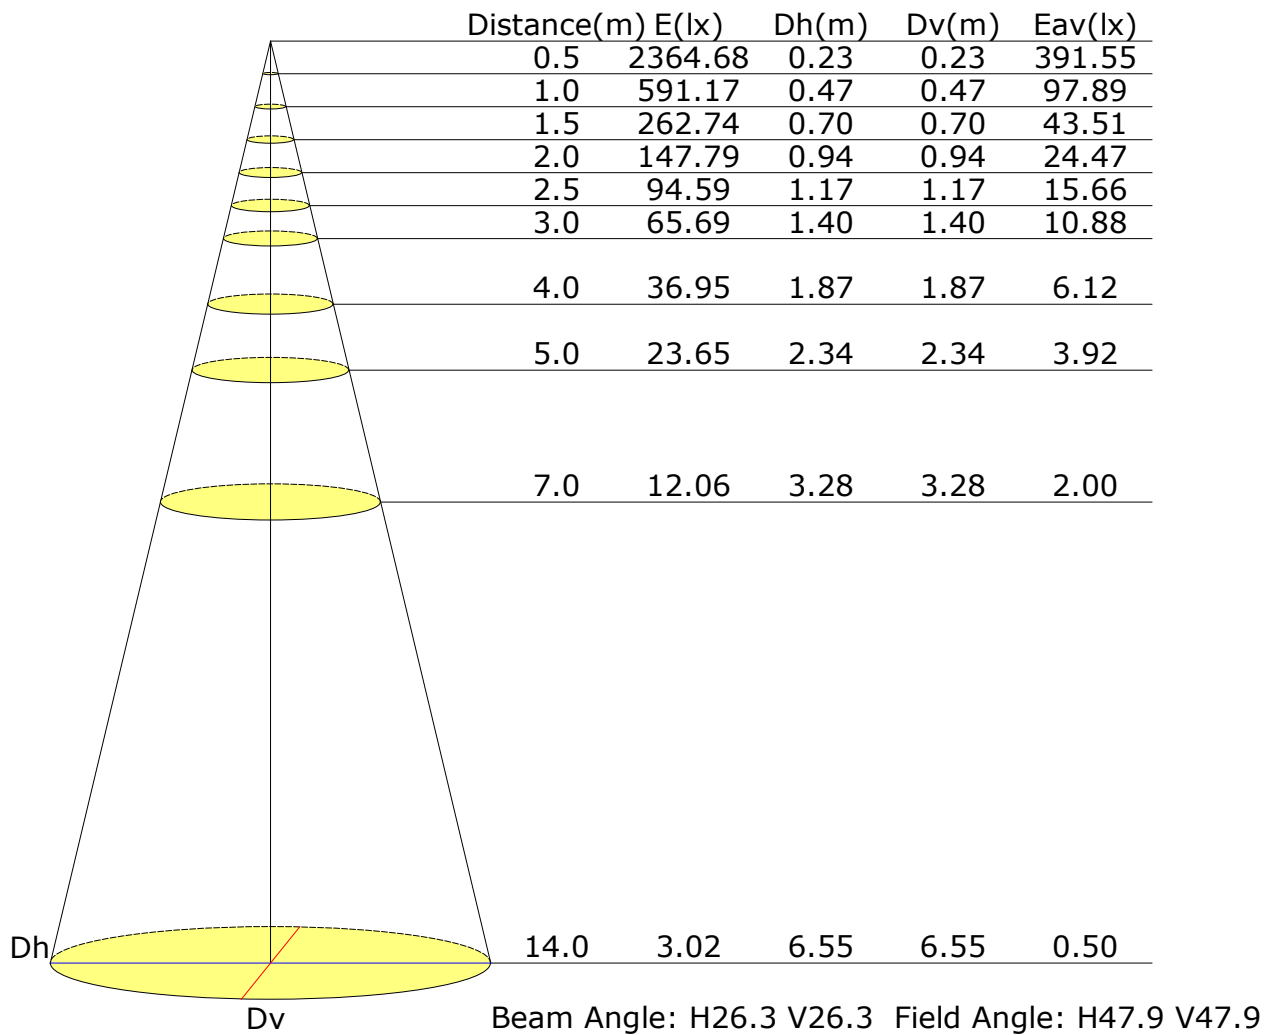

Vertical IsoLux Plot

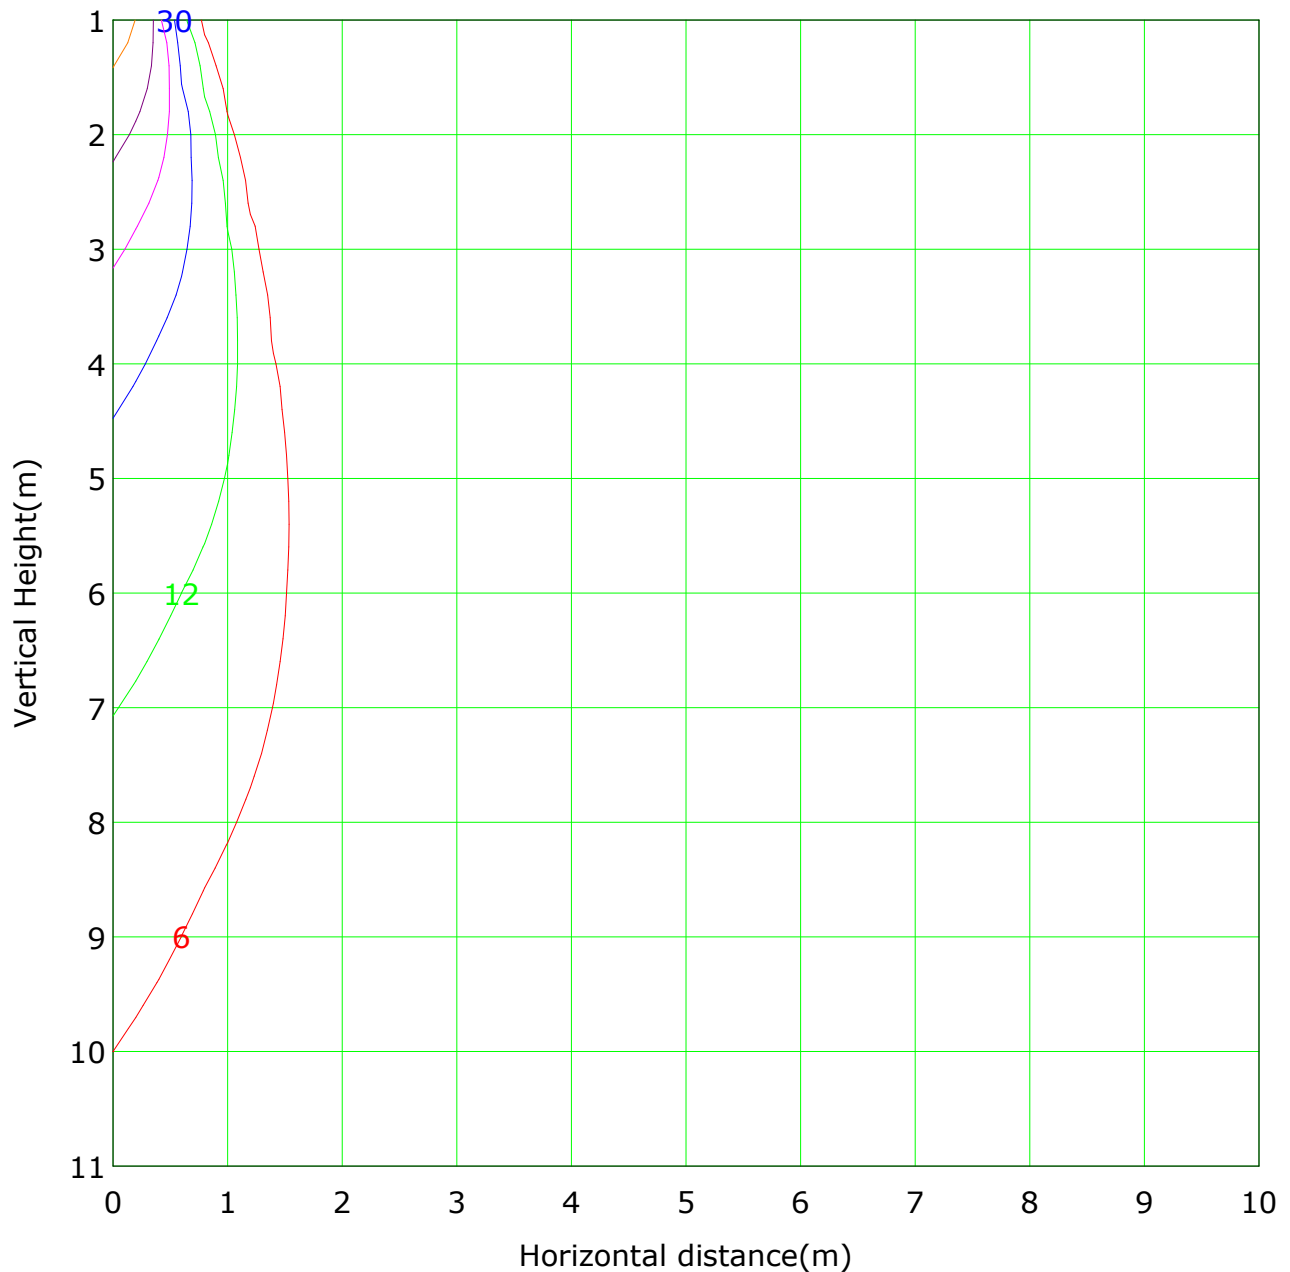


Lowest(m): 1m Highest(m): 11 Max Lux: 591	
(1%): 6 lx	(2%): 12 lx
(5%): 30 lx	(10%): 59 lx
(20%): 118 lx	(50%): 296 lx
(100%): 591 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

The average illuminance effective figure

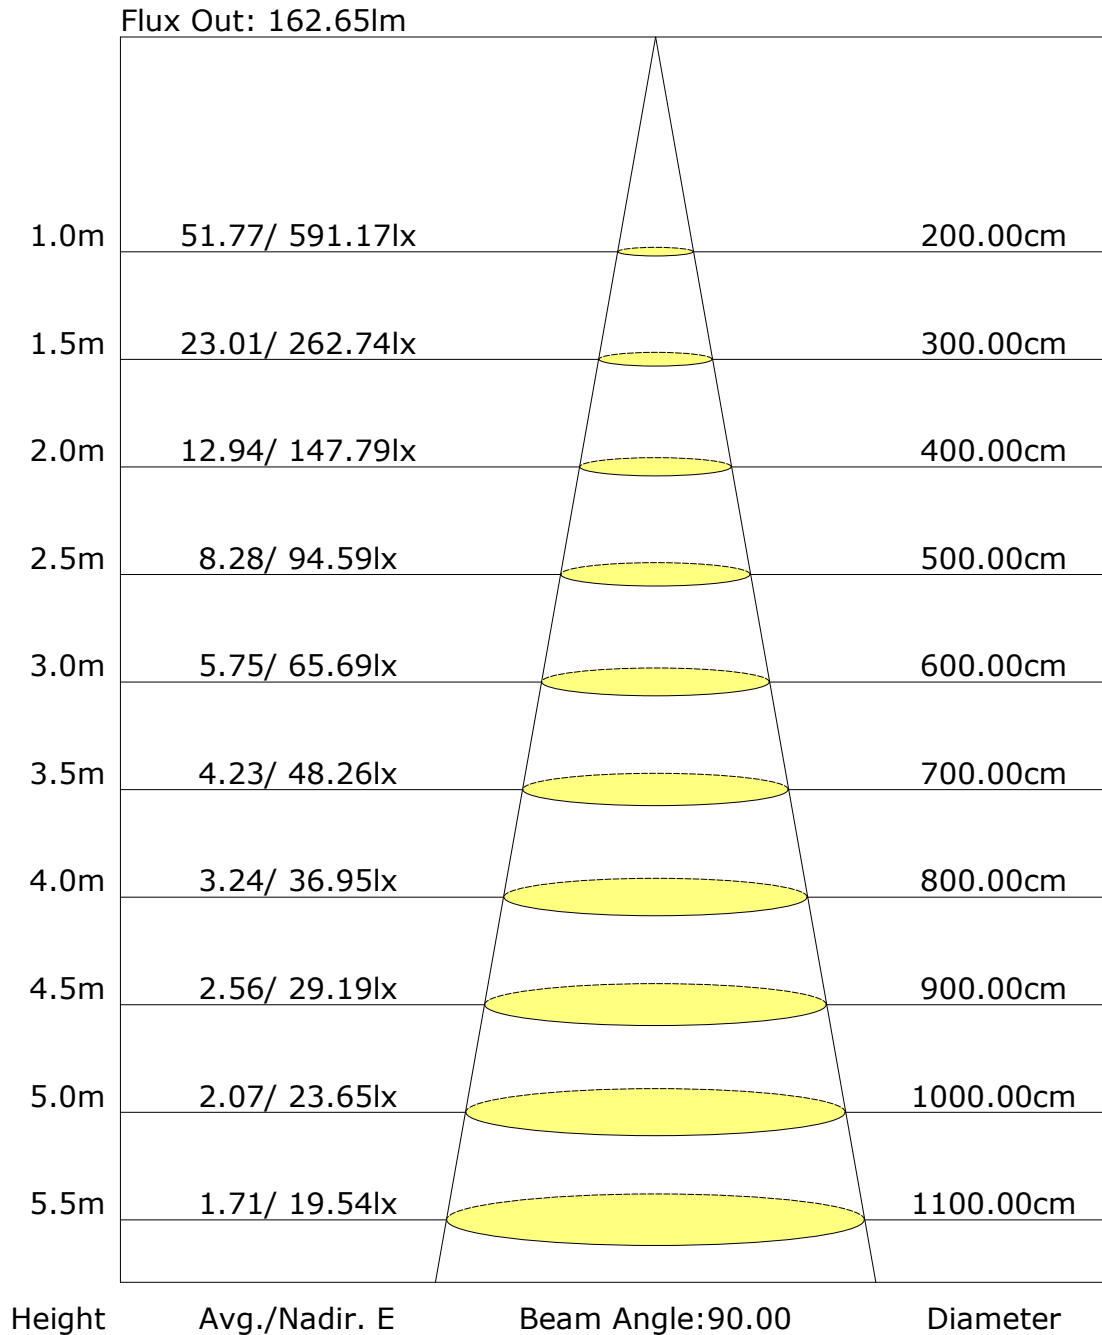

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector:

Unit: cd

Gamma Plane (°):0.0-90.0:5.0
Test Device: CHL-6E
Distance: 3.000 m
Humidity:
Inspector: